



# Comprehensive Energy Audit For Nunam Iqua Clinic



---

Prepared For  
**Native Village of Nunam Iqua**

**June 27, 2012**

**Prepared By:**

**ANTHC-DEHE  
1901 Bragaw Street, Suite 200  
Anchorage, AK 99508**

## Table of Contents

1. EXECUTIVE SUMMARY .....	3
2. AUDIT AND ANALYSIS BACKGROUND .....	4
2.1 Program Description .....	4
2.2 Audit Description .....	4
2.3. Method of Analysis .....	5
2.4 Limitations of Study .....	7
3. Nunam Iqua Clinic .....	7
3.1. Building Description .....	7
3.2 Predicted Energy Use .....	8
3.2.1 Energy Usage / Tariffs .....	8
3.2.2 Energy Use Index (EUI) .....	11
3.3 AkWarm© Building Simulation .....	12
4. ENERGY COST SAVING MEASURES.....	13
4.1 Summary of Results .....	13
4.2 Interactive Effects of Projects .....	13
5. ENERGY EFFICIENCY ACTION PLAN .....	15
Appendix A – Listing of Energy Conservation and Renewable Energy Websites .....	15

### PREFACE

The Energy Projects Group at the Alaska Native Tribal Health Consortium (ANTHC) prepared this document for the Native Village of Nunam Iqua. The authors of this report are Carl Remley, Certified Energy Auditor (CEA) and Certified Energy Manager and Gavin Dixon.

The purpose of this report is to provide a comprehensive document that summarizes the findings and analysis that resulted from an energy audit conducted over the past couple months by the Energy Projects Group of ANTHC. This report analyzes historical energy use and identifies costs and savings of recommended energy efficiency measures. Discussions of site specific concerns and an Energy Efficiency Action Plan are also included in this report.

### ACKNOWLEDGMENTS

The Energy Projects Group gratefully acknowledges the assistance of Olivia Horn-Moses, Tribal Administrator for the Native Village of Nunam Iqua, and Francine Afcan, Health Aide.

# 1. EXECUTIVE SUMMARY

This report was prepared for the YKHC. The scope of the audit focused on Nunam Iqua Clinic. The scope of this report is a comprehensive energy study, which included an analysis of building shell, interior and exterior lighting systems, HVAC systems, and plug loads.

Based on electricity and fuel oil prices in effect at the time of the audit, the annual predicted energy costs for the buildings analyzed are \$4,430 for electricity and \$6,531 for #1 oil. The total energy costs are \$10,961 per year.

It should be noted that this facility received the power cost equalization (PCE) subsidy from the state of Alaska last year. If this facility had not received PCE, then total electrical costs would have been \$8,385.

Table 1.1 below summarizes the energy efficiency measures analyzed for the Nunam Iqua Clinic. Listed are the estimates of the annual savings, installed costs, and two different financial measures of investment return.

<b>Table 1.1</b> <b>PRIORITY LIST – ENERGY EFFICIENCY MEASURES</b>						
Rank	Feature	Improvement Description	Annual Energy Savings	Installed Cost	Savings to Investment Ratio, SIR <sup>1</sup>	Simple Payback (Years) <sup>2</sup>
1	Other Electrical - Controls Retrofit: Water Line Heat Tape	Turn off water line heat tape, use for thaw recovery only.	\$776	\$10	480.64	0.0
2	Other Electrical - Combined Retrofit: Water Circulation Pump	Turn off water circulation pump in the summer time.	\$32	\$10	19.47	0.3
3	Air Tightening: Break room Window and front door	Perform air sealing to reduce air leakage by 200 cfm at 50 Pascals.	\$348	\$400	8.05	1.2
4	Lighting - Power Retrofit: Exterior Lights	Replace with 2 LED 10W Module Electronic wall packs	\$76	\$300	3.71	3.9
5	Setback Thermostat: Nunam Iqua Health Clinic	Implement a Heating Temperature Unoccupied Setback to 60.0 deg F for the Nunam Iqua Health Clinic space. Replace DDC system with simpler control system.	\$840	\$5,000	2.26	6.0
<b>TOTAL, all measures</b>			<b>\$2,073</b>	<b>\$5,720</b>	<b>3.61</b>	<b>2.8</b>

## Table Notes:

<sup>1</sup> Savings to Investment Ratio (SIR) is a life-cycle cost measure calculated by dividing the total savings over the life of a project (expressed in today's dollars) by its investment costs. The SIR is an indication of the profitability of a measure; the higher the SIR, the more profitable the project. An SIR greater than 1.0 indicates a cost-effective project (i.e. more savings than cost).

Remember that this profitability is based on the position of that Energy Efficiency Measure (EEM) in the overall list and assumes that the measures above it are implemented first.

<sup>2</sup> Simple Payback (SP) is a measure of the length of time required for the savings from an EEM to payback the investment cost, not counting interest on the investment and any future changes in energy prices. It is calculated by dividing the investment cost by the expected first-year savings of the EEM.

With all of these energy efficiency measures in place, the annual utility cost can be reduced by \$2,073 per year, or 18.9% of the buildings' total energy costs. These measures are estimated to cost \$5,720, for an overall simple payback period of 2.8 years.

Table 1.2 below is a breakdown of the annual energy cost across various energy end use types, such as Space Heating and Water Heating. The first row in the table shows the breakdown for the building as it is now. The second row shows the expected breakdown of energy cost for the building assuming all of the retrofits in this report are implemented. Finally, the last row shows the annual energy savings that will be achieved from the retrofits.

<b>Table 1.2</b>										
<b>Annual Energy Cost Estimate</b>										
<b>Description</b>	<b>Space Heating</b>	<b>Space Cooling</b>	<b>Water Heating</b>	<b>Lighting</b>	<b>Refrigeration</b>	<b>Other Electrical</b>	<b>Cooking</b>	<b>Clothes Drying</b>	<b>Ventilation Fans</b>	<b>Total Cost</b>
Existing Building	\$5,858	\$0	\$937	\$1,102	\$196	\$2,868	\$0	\$0	\$0	<b>\$10,961</b>
With All Proposed Retrofits	\$4,687	\$0	\$937	\$1,026	\$196	\$2,043	\$0	\$0	\$0	<b>\$8,888</b>
SAVINGS	\$1,171	\$0	\$0	\$76	\$0	\$826	\$0	\$0	\$0	<b>\$2,073</b>

## **2. AUDIT AND ANALYSIS BACKGROUND**

### ***2.1 Program Description***

This audit included services to identify, develop, and evaluate energy efficiency measures at the Nunam Iqua Clinic. The scope of this project included evaluating building shell, lighting and other electrical systems, and HVAC equipment, motors and pumps. Measures were analyzed based on life-cycle-cost techniques, which include the initial cost of the equipment, life of the equipment, annual energy cost, annual maintenance cost, and a discount rate of 3.0%/year in excess of general inflation.

### ***2.2 Audit Description***

Preliminary audit information was gathered in preparation for the site survey. The site survey provides critical information in deciphering where energy is used and what opportunities exist

within a building. The entire site was surveyed to inventory the following to gain an understanding of how each building operates:

- Building envelope (roof, windows, etc.)
- Heating, ventilation, and air conditioning equipment (HVAC)
- Lighting systems and controls
- Building-specific equipment

The building site visit was performed to survey all major building components and systems. The site visit included detailed inspection of energy consuming components. Summary of building occupancy schedules, operating and maintenance practices, and energy management programs provided by the building manager were collected along with the system and components to determine a more accurate impact on energy consumption.

Details collected from Nunam Iqua Clinic enable a model of the building's energy usage to be developed, highlighting the building's total energy consumption, energy consumption by specific building component, and equivalent energy cost. The analysis involves distinguishing the different fuels used on site, and analyzing their consumption in different activity areas of the building.

Nunam Iqua Clinic is classified as being made up of the following activity areas:

1) Nunam Iqua Health Clinic: 1,714 square feet

In addition, the methodology involves taking into account a wide range of factors specific to the building. These factors are used in the construction of the model of energy used. The factors include:

- Occupancy hours
- Local climate conditions
- Prices paid for energy

### ***2.3. Method of Analysis***

Data collected was processed using AkWarm© Energy Use Software to estimate energy savings for each of the proposed energy efficiency measures (EEMs). The recommendations focus on the building envelope; HVAC; lighting, plug load, and other electrical improvements; and motor and pump systems that will reduce annual energy consumption.

EEMs are evaluated based on building use and processes, local climate conditions, building construction type, function, operational schedule, existing conditions, and foreseen future plans. Energy savings are calculated based on industry standard methods and engineering estimations.

Our analysis provides a number of tools for assessing the cost effectiveness of various improvement options. These tools utilize **Life-Cycle Costing**, which is defined in this context as a method of cost analysis that estimates the total cost of a project over the period of time that includes both the construction cost and ongoing maintenance and operating costs.

## **Savings to Investment Ratio (SIR) = Savings divided by Investment**

**Savings** includes the total discounted dollar savings considered over the life of the improvement. When these savings are added up, changes in future fuel prices as projected by the Department of Energy are included. Future savings are discounted to the present to account for the time-value of money (i.e. money's ability to earn interest over time). The **Investment** in the SIR calculation includes the labor and materials required to install the measure. An SIR value of at least 1.0 indicates that the project is cost-effective—total savings exceed the investment costs.

**Simple payback** is a cost analysis method whereby the investment cost of a project is divided by the first year's savings of the project to give the number of years required to recover the cost of the investment. This may be compared to the expected time before replacement of the system or component will be required. For example, if a boiler costs \$12,000 and results in a savings of \$1,000 in the first year, the payback time is 12 years. If the boiler has an expected life to replacement of 10 years, it would not be financially viable to make the investment since the payback period of 12 years is greater than the project life.

The Simple Payback calculation does not consider likely increases in future annual savings due to energy price increases. As an offsetting simplification, simple payback does not consider the need to earn interest on the investment (i.e. it does not consider the time-value of money). Because of these simplifications, the SIR figure is considered to be a better financial investment indicator than the Simple Payback measure.

Measures are implemented in order of cost-effectiveness. The program first calculates individual SIRs, and ranks all measures by SIR, higher SIRs at the top of the list. An individual measure must have an individual  $SIR \geq 1$  to make the cut. Next the building is modified and re-simulated with the highest ranked measure included. Now all remaining measures are re-evaluated and ranked, and the next most cost-effective measure is implemented. AkWarm goes through this iterative process until all appropriate measures have been evaluated and installed.

It is important to note that the savings for each recommendation is calculated based on implementing the most cost effective measure first, and then cycling through the list to find the next most cost effective measure. Implementation of more than one EEM often affects the savings of other EEMs. The savings may in some cases be relatively higher if an individual EEM is implemented in lieu of multiple recommended EEMs. For example implementing a reduced operating schedule for inefficient lighting will result in relatively high savings. Implementing a reduced operating schedule for newly installed efficient lighting will result in lower relative savings, because the efficient lighting system uses less energy during each hour of operation. If multiple EEM's are recommended to be implemented, AkWarm calculates the combined savings appropriately.

Cost savings are calculated based on estimated initial costs for each measure. Installation costs include labor and equipment to estimate the full up-front investment required to implement a change. Costs are derived from Means Cost Data, industry publications, and local contractors and equipment suppliers.

## ***2.4 Limitations of Study***

All results are dependent on the quality of input data provided, and can only act as an approximation. In some instances, several methods may achieve the identified savings. This report is not intended as a final design document. The design professional or other persons following the recommendations shall accept responsibility and liability for the results.

## **3. Nunam Iqua Clinic**

### ***3.1. Building Description***

The 1,714 square foot Nunam Iqua Clinic was constructed in 2002, with a normal occupancy of 4 people. The number of hours of operation for this building average 6.3 hours per day, considering all seven days of the week.

#### **Description of Building Shell**

The exterior walls are constructed with six inch structurally insulated panels with 5.5 inches of polyurethane insulation.

The roof of the building is a warm roof with 5.5 inches of polyurethane insulation.

The floor of the building is built on pilings with 7 inches of polyurethane insulation.

Typical windows throughout the building are double paned vinyl frame windows.

Doors are metal with an EPS core and a metal edge.

#### **Description of Heating Plants**

The Heating Plants used in the building are:

##### **Williamson Thermoflo Furnace**

Fuel Type:	#1 Oil
Input Rating:	175,000 BTU/hr
Steady State Efficiency:	82 %
Idle Loss:	1.5 %
Heat Distribution Type:	Air

##### **Bock Hot Water heater**

Fuel Type:	#1 Oil
Input Rating:	104,000 BTU/hr
Steady State Efficiency:	82 %
Idle Loss:	1.5 %
Heat Distribution Type:	Water
Boiler Operation:	All Year

## **Space Heating Distribution Systems**

An in ceiling ducted supply and return air system supply's heat to the building from the furnace with a two horsepower fan. The unit also has the capacity to use 100% outside air in the summer for cooling

## **Domestic Hot Water System**

A 32 gallon Bock oil fired hot water heater supplies the building with 115 degree hot water. The facility uses about 10 gallons of hot water per day primarily for hand washing and occasionally showers.

## **Lighting**

Lighting in the building is made up of T8 electronic ballast fixtures with two to three 32 watt bulbs each. Many of the exam rooms and offices have occupancy sensors. There are two 60 watt incandescent lights that serve as the exterior lighting for the facility.

## **Plug Loads**

Several computers, a copy machine, phones, a medical refrigerator, a break room refrigerator, various medical equipment, dental equipment, and a coffee pot make up the majority of the plug loads in the facility. There is additional telemedicine and telecommunications system which is a significant load in the facility.

## **Major Equipment**

A domestic water circulation pump circulates year round currently to provide water from the water main.

A heat tape on the water service and a heat tape on the sewer service line currently operate all winter long.

## ***3.2 Predicted Energy Use***

### **3.2.1 Energy Usage / Tariffs**

The electric usage profile charts (below) represents the predicted electrical usage for the building. If actual electricity usage records were available, the model used to predict usage was calibrated to approximately match actual usage. The electric utility measures consumption in kilowatt-hours (kWh) and maximum demand in kilowatts (kW). One kWh usage is equivalent to 1,000 watts running for one hour.

The fuel oil usage profile shows the fuel oil usage for the building. Fuel oil consumption is measured in gallons. One gallon of #1 Fuel Oil provides approximately 132,000 BTUs of energy.

The following is a list of the utility companies providing energy to the building and the class of service provided:



## Electricity: Nunam Iqua Electric - Commercial - Sm

The average cost for each type of fuel used in this building is shown below in Table 3.1. This figure includes all surcharges, subsidies, and utility customer charges:

Table 3.1 – Average Energy Cost	
Description	Average Energy Cost
Electricity	\$ 0.28/kWh
#1 Oil	\$ 6.76/gallons

### 3.2.1.1 Total Energy Use and Cost Breakdown

At current rates, YKHC pays approximately \$10,961 annually for electricity and other fuel costs for the Nunam Iqua Clinic.

Figure 3.1 below reflects the estimated distribution of costs across the primary end uses of energy based on the AkWarm© computer simulation. Comparing the “Retrofit” bar in the figure to the “Existing” bar shows the potential savings from implementing all of the energy efficiency measures shown in this report.

**Figure 3.1**  
**Annual Energy Costs by End Use**

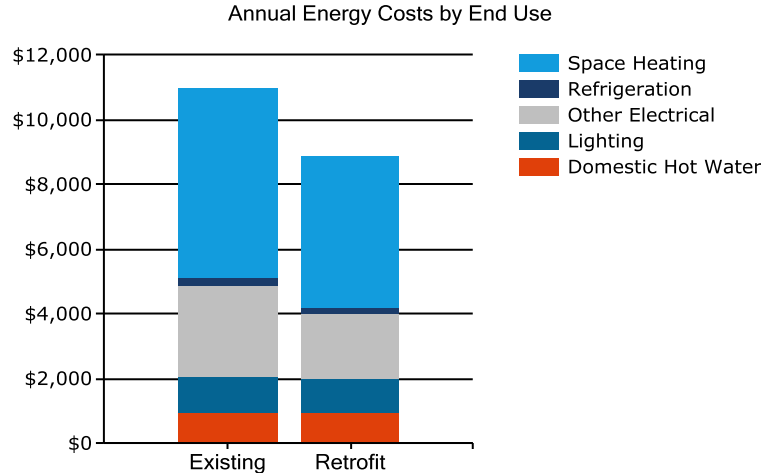



Figure 3.2 below shows how the annual energy cost of the building splits between the different fuels used by the building. The “Existing” bar shows the breakdown for the building as it is now; the “Retrofit” bar shows the predicted costs if all of the energy efficiency measures in this report are implemented.

**Figure 3.2**  
**Annual Energy Costs by Fuel Type**



Figure 3.3 below addresses only Space Heating costs. The figure shows how each heat loss component contributes to those costs; for example, the figure shows how much annual space heating cost is caused by the heat loss through the Walls/Doors. For each component, the space heating cost for the Existing building is shown (blue bar) and the space heating cost assuming all retrofits are implemented (yellow bar) are shown.

**Figure 3.3**  
**Annual Space Heating Cost by Component**

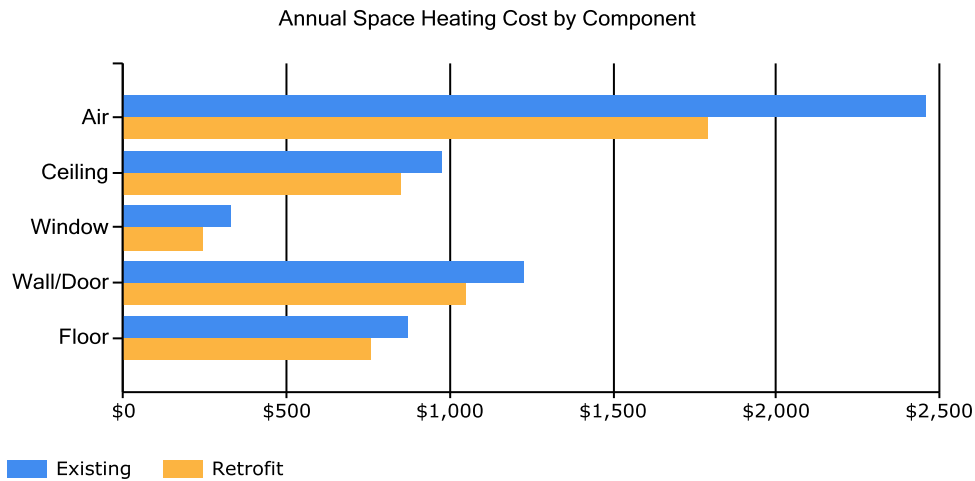

The tables below show AkWarm’s estimate of the monthly fuel use for each of the fuels used in the building. For each fuel, the fuel use is broken down across the energy end uses. Note, in the tables below “DHW” refers to Domestic Hot Water heating.

Electrical Consumption (kWh)												
	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sept	Oct	Nov	Dec
Other_Electrical	1093	996	1093	1058	1093	410	423	423	410	1093	1058	1093
Refrigeration	59	54	59	57	59	57	59	59	57	59	57	59
Lighting	349	318	349	338	304	295	304	304	338	349	338	349
DHW	4	4	4	4	4	4	4	4	4	4	4	4
Space_Heating	152	133	120	73	31	12	8	13	25	68	107	154

Fuel Oil #1 Consumption (Gallons)												
	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sept	Oct	Nov	Dec
DHW	12	11	12	11	12	11	12	12	11	12	11	12
Space_Heating	129	113	104	68	36	20	18	22	31	64	94	130

### 3.2.2 Energy Use Index (EUI)

Energy Use Index (EUI) is a measure of a building's annual energy utilization per square foot of building. This calculation is completed by converting all utility usage consumed by a building for one year, to British Thermal Units (Btu) or kBtu, and dividing this number by the building square footage. EUI is a good measure of a building's energy use and is utilized regularly for comparison of energy performance for similar building types. The Oak Ridge National Laboratory (ORNL) Buildings Technology Center under a contract with the U.S. Department of Energy maintains a Benchmarking Building Energy Performance Program. The ORNL website determines how a building's energy use compares with similar facilities throughout the U.S. and in a specific region or state.

Source use differs from site usage when comparing a building's energy consumption with the national average. Site energy use is the energy consumed by the building at the building site only. Source energy use includes the site energy use as well as all of the losses to create and distribute the energy to the building. Source energy represents the total amount of raw fuel that is required to operate the building. It incorporates all transmission, delivery, and production losses, which allows for a complete assessment of energy efficiency in a building. The type of utility purchased has a substantial impact on the source energy use of a building. The EPA has determined that source energy is the most comparable unit for evaluation purposes and overall global impact. Both the site and source EUI ratings for the building are provided to understand and compare the differences in energy use. The site and source EUIs for this building are calculated as follows. (See Table 3.4 for details):

$$\text{Building Site EUI} = \frac{(\text{Electric Usage in kBtu} + \text{Fuel Oil Usage in kBtu})}{\text{Building Square Footage}}$$

$$\text{Building Source EUI} = \frac{(\text{Electric Usage in kBtu} \times \text{SS Ratio} + \text{Fuel Oil Usage in kBtu} \times \text{SS Ratio})}{\text{Building Square Footage}}$$

where "SS Ratio" is the Source Energy to Site Energy ratio for the particular fuel.

**Table 3.4**  
**Nunam Iqua Clinic EUI Calculations**

Energy Type	Building Fuel Use per Year	Site Energy Use per Year, kBTU	Source/Site Ratio	Source Energy Use per Year, kBTU
Electricity	15,822 kWh	53,999	3.340	180,358
#1 Oil	966 gallons	127,524	1.010	128,799
<b>Total</b>		<b>181,523</b>		<b>309,157</b>
BUILDING AREA		1,714	Square Feet	
BUILDING SITE EUI		106	kBTU/Ft <sup>2</sup> /Yr	
<b>BUILDING SOURCE EUI</b>		<b>180</b>	<b>kBTU/Ft<sup>2</sup>/Yr</b>	
* Site - Source Ratio data is provided by the Energy Star Performance Rating Methodology for Incorporating Source Energy Use document issued March 2011.				

### ***3.3 AkWarm© Building Simulation***

An accurate model of the building performance can be created by simulating the thermal performance of the walls, roof, windows and floors of the building. The HVAC system and central plant are modeled as well, accounting for the outside air ventilation required by the building and the heat recovery equipment in place.

The model uses local weather data and is trued up to historical energy use to ensure its accuracy. The model can be used now and in the future to measure the utility bill impact of all types of energy projects, including improving building insulation, modifying glazing, changing air handler schedules, increasing heat recovery, installing high efficiency boilers, using variable air volume air handlers, adjusting outside air ventilation and adding cogeneration systems.

For the purposes of this study, the Nunam Iqua Clinic was modeled using AkWarm© energy use software to establish a baseline space heating and cooling energy usage. Climate data from Nunam Iqua was used for analysis. From this, the model was calibrated to predict the impact of theoretical energy savings measures. Once annual energy savings from a particular measure were predicted and the initial capital cost was estimated, payback scenarios were approximated. Equipment cost estimate calculations are provided in Appendix D.

#### ***Limitations of AkWarm© Models***

- The model is based on typical mean year weather data for Nunam Iqua. This data represents the average ambient weather profile as observed over approximately 30 years. As such, the gas and electric profiles generated will not likely compare perfectly with actual energy billing information from any single year. This is especially true for years with extreme warm or cold periods, or even years with unexpectedly moderate weather.
- The heating and cooling load model is a simple two-zone model consisting of the building's core interior spaces and the building's perimeter spaces. This simplified approach loses accuracy for buildings that have large variations in cooling/heating loads across different parts of the building.
- The model does not model HVAC systems that simultaneously provide both heating and cooling to the same building space (typically done as a means of providing temperature control in the space).

The energy balances shown in Section 3.1 were derived from the output generated by the AkWarm© simulations.

## 4. ENERGY COST SAVING MEASURES

### 4.1 Summary of Results

The energy saving measures are summarized in Table 4.1. Please refer to the individual measure descriptions later in this report for more detail.

<b>Table 4.1</b> <b>Nunam Iqua Clinic, Nunam Iqua, Alaska</b> <b>PRIORITY LIST – ENERGY EFFICIENCY MEASURES</b>						
Rank	Feature	Improvement Description	Annual Energy Savings	Installed Cost	Savings to Investment Ratio, SIR	Simple Payback (Years)
1	Other Electrical - Controls Retrofit: Water Line Heat Tape	Turn off water line heat tape, use for thaw recovery only.	\$776	\$10	480.64	0.0
2	Other Electrical - Combined Retrofit: Water Circulation Pump	Turn off water circulation pump in the summer time.	\$32	\$10	19.47	0.3
3	Air Tightening: Break room Window and front door	Perform air sealing to reduce air leakage by 200 cfm at 50 Pascals.	\$348	\$400	8.05	1.2
4	Lighting - Power Retrofit: Exterior Lights	Replace with 2 LED 10W Module Electronic wall packs	\$76	\$300	3.71	3.9
5	Setback Thermostat: Nunam Iqua Health Clinic	Implement a Heating Temperature Unoccupied Setback to 60.0 deg F for the Nunam Iqua Health Clinic space. Replace DDC system with simpler control system.	\$840	\$5,000	2.26	6.0
<b>TOTAL, all measures</b>			<b>\$2,073</b>	<b>\$5,720</b>	<b>3.61</b>	<b>2.8</b>

### 4.2 Interactive Effects of Projects

The savings for a particular measure are calculated assuming all recommended EEMs coming before that measure in the list are implemented. If some EEMs are not implemented, savings for the remaining EEMs will be affected. For example, if ceiling insulation is not added, then savings from a project to replace the heating system will be increased, because the heating system for the building supplies a larger load.

In general, all projects are evaluated sequentially so energy savings associated with one EEM would not also be attributed to another EEM. By modeling the recommended project sequentially, the analysis accounts for interactive affects among the EEMs and does not “double count” savings.

Interior lighting, plug loads, facility equipment, and occupants generate heat within the building. When the building is in cooling mode, these items contribute to the overall cooling demands of the building; therefore, lighting efficiency improvements will reduce cooling requirements in air-conditioned

buildings. Conversely, lighting-efficiency improvements are anticipated to slightly increase heating requirements. Heating penalties and cooling benefits were included in the lighting project analysis.

## 4.3 Building Shell Measures

### 4.3.1 Air Sealing Measures

Rank	Location	Existing Air Leakage Level (cfm@50/75 Pa)		Recommended Air Leakage Reduction (cfm@50/75 Pa)	
3	Break room Window and front door	Air Tightness estimated as: 1500 cfm at 50 Pascals		Perform air sealing to reduce air leakage by 200 cfm at 50 Pascals.	
Installation Cost		\$400	Estimated Life of Measure (yrs)	10	Energy Savings (/yr)
Breakeven Cost		\$3,218	Savings-to-Investment Ratio	8.0	Simple Payback yrs
Auditors Notes: Break room window needs pane replaced and window removed and re-installed so it closes properly and front door needs additional weather-stripping on bottom of door.					

## 4.4 Mechanical Equipment Measures

### 4.4.1 Night Setback Thermostat Measures

Rank	Building Space	Recommendation			
5	Nunam Iqua Health Clinic	Implement a Heating Temperature Unoccupied Setback to 60.0 deg F for the Nunam Iqua Health Clinic space.			
Installation Cost		\$5,000	Estimated Life of Measure (yrs)	15	Energy Savings (/yr)
Breakeven Cost		\$11,316	Savings-to-Investment Ratio	2.3	Simple Payback yrs
Auditors Notes: Setback would be from normally scheduled hours which are from 9 to 4 Monday through Friday The DDC system needs to be replaced with a simpler system. This avenue is being pursued by agreement with YKHC.					

## 4.5 Electrical & Appliance Measures

### 4.5.1 Lighting Measures

The goal of this section is to present any lighting energy conservation measures that may also be cost beneficial. It should be noted that replacing current bulbs with more energy-efficient equivalents will have a small effect on the building heating and cooling loads. The building cooling load will see a small decrease from an upgrade to more efficient bulbs and the heating load will see a small increase, as the more energy efficient bulbs give off less heat.

#### 4.5.1a Lighting Measures – Replace Existing Fixtures/Bulbs

Rank	Location	Existing Condition		Recommendation	
4	Exterior Lights	2 INCAN A Lamp, Std 60W with Manual Switching		Replace with 2 LED 10W Module Electronic wall packs	
Installation Cost		\$300	Estimated Life of Measure (yrs)	20	Energy Savings (/yr)
Breakeven Cost		\$1,113	Savings-to-Investment Ratio	3.7	Simple Payback yrs
Auditors Notes: The new LED lamps will last approximately 20 times as long as the incandescent lamps used now, use less energy, and function better in the cold.					

## 4.5.2 Other Electrical Measures

Rank	Location	Description of Existing	Efficiency Recommendation
1	Water Line Heat Tape	Water Line Heat Tape with Manual Switching	Improve Manual Switching
<b>Installation Cost</b>	\$10	<b>Estimated Life of Measure (yrs)</b>	7
<b>Breakeven Cost</b>	\$4,806	<b>Savings-to-Investment Ratio</b>	480.6
		<b>Energy Savings (/yr)</b>	\$776
		<b>Simple Payback yrs</b>	0
Auditors Notes: The heat tape on the water line should be used only as a recovery system in case the water line freezes. The water circulation pump should be used solely, and should keep the water from freezing. If it is incapable, a larger water circulation pump should be installed.			

Rank	Location	Description of Existing	Efficiency Recommendation
2	Water Circulation Pump	Domestic Water Circulator with Manual Switching	Replace with Domestic Water Circulator and Improve Manual Switching
<b>Installation Cost</b>	\$10	<b>Estimated Life of Measure (yrs)</b>	7
<b>Breakeven Cost</b>	\$195	<b>Savings-to-Investment Ratio</b>	19.5
		<b>Energy Savings (/yr)</b>	\$32
		<b>Simple Payback yrs</b>	0
Auditors Notes: There is no need to run the circulator in the summer. It should be shut off during the four summer months.			

## 5. ENERGY EFFICIENCY ACTION PLAN

Through inspection of the energy-using equipment on-site and discussions with site facilities personnel, this energy audit has identified several energy-saving measures. The measures will reduce the amount of fuel burned and electricity used at the site. The projects will not degrade the performance of the building and, in some cases, will improve it.

Several types of EEMs can be implemented immediately by building staff, and others will require various amounts of lead time for engineering and equipment acquisition. In some cases, there are logical advantages to implementing EEMs concurrently. For example, if the same electrical contractor is used to install both lighting equipment and motors, implementation of these measures should be scheduled to occur simultaneously.

## Appendix A – Listing of Energy Conservation and Renewable Energy Websites

### Lighting

Illumination Engineering Society - <http://www.iesna.org/>

Energy Star Compact Fluorescent Lighting Program - [www.energystar.gov/index.cfm?c=cfls.pr\\_cfls](http://www.energystar.gov/index.cfm?c=cfls.pr_cfls)

DOE Solid State Lighting Program - <http://www1.eere.energy.gov/buildings/ssl/>

DOE office of Energy Efficiency and Renewable Energy - [http://apps1.eere.energy.gov/consumer/your\\_workplace/](http://apps1.eere.energy.gov/consumer/your_workplace/)

Energy Star – [http://www.energystar.gov/index.cfm?c=lighting.pr\\_lighting](http://www.energystar.gov/index.cfm?c=lighting.pr_lighting)

### Hot Water Heaters

Heat Pump Water Heaters -

[http://apps1.eere.energy.gov/consumer/your\\_home/water\\_heating/index.cfm/mytopic=12840](http://apps1.eere.energy.gov/consumer/your_home/water_heating/index.cfm/mytopic=12840)

### **Solar Water Heating**

FEMP Federal Technology Alerts – [http://www.eere.energy.gov/femp/pdfs/FTA\\_solwat\\_heat.pdf](http://www.eere.energy.gov/femp/pdfs/FTA_solwat_heat.pdf)

Solar Radiation Data Manual – <http://rredc.nrel.gov/solar/pubs/redbook>

### **Plug Loads**

DOE office of Energy Efficiency and Renewable Energy – [http://apps1.eere.energy.gov/consumer/your\\_workplace/](http://apps1.eere.energy.gov/consumer/your_workplace/)

Energy Star – [http://www.energystar.gov/index.cfm?fuseaction=find\\_a\\_product](http://www.energystar.gov/index.cfm?fuseaction=find_a_product)

The Greenest Desktop Computers of 2008 - <http://www.metaefficient.com/computers/the-greenest-pcs-of-2008.html>

### **Wind**

AWEA Web Site – <http://www.awea.org>

National Wind Coordinating Collaborative – <http://www.nationalwind.org>

Utility Wind Interest Group site: <http://www.uwig.org>

WPA Web Site – <http://www.windpoweringamerica.gov>

Homepower Web Site: <http://homepower.com>

Windustry Project: <http://www.windustry.com>

### **Solar**

NREL – <http://www.nrel.gov/rredc/>

Firstlook – <http://firstlook.3tiergroup.com>

TMY or Weather Data – [http://rredc.nrel.gov/solar/old\\_data/nsrdb/1991-2005/tmy3/](http://rredc.nrel.gov/solar/old_data/nsrdb/1991-2005/tmy3/)

State and Utility Incentives and Utility Policies - <http://www.dsireusa.org>