

Investigative Energy Audit For

Tyonek Tribal Center



Prepared For Native Village of Tyonek

August 30, 2017

Prepared By: Kevin Ulrich & Kelli Whelan

ANTHC-DEHE 4500 Diplomacy Drive Anchorage, AK 99508

Table of Contents

PREFACE	2
ACKNOWLEDGMENTS	
OVERVIEW	3
ENERGY BASELINE	3
Table 1: Predicted Annual Energy Use for the Tyonek Tribal Center	3
PROPOSED ENERGY EFFICIENCY MEASURES (EEM)	
FACILITY DESCRIPTION	
PROJECT FINANCING	6
MEASUREMENT AND VERIFICATION	
Appendix A –Energy Billing Data	8
Appendix B – Energy Audit Report – Project Summary	
Appendix C – Actual Fuel Use versus Modeled Fuel Use	10
Appendix D - EUI Calculation Details	11
Appendix E – Materials List and Labor Estimation	13
Appendix F – Materials Specifications	

PREFACE

The purpose of this report is to provide guidance in reducing facility operating costs and enhance the sustainability of this community. The report assesses the current energy usage of the facility, provide options for reducing the amount of energy used, and evaluate the cost vs. benefit of each option.


Discussions of site specific concerns, financing options, general facility information, and an Energy Efficiency Action Plan are also included in this report.

ACKNOWLEDGMENTS

The ANTHC Rural Energy Initiative gratefully acknowledges the assistance of President Arthur Standifer, Tribal Administrator Sandi Kroto, and Tyonek Tribal Conservation District Program Assistant Tonya Kaloa.

This report was prepared for the Native Village of Tyonek. The scope of the audit focused on the Tyonek Tribal Center and includes an analysis of building occupancy schedules, building shell, heating systems, heating and ventilations systems, domestic hot water, lighting, and other electrical loads. The Tyonek Tribal Center was constructed around 1960 and is approximately 4,900 square feet. The building serves as a common area for large community events and also houses the offices for the Native Village of Tyonek.

Annual Energy Costs by Fuel Type



ENERGY BASELINE

Based on unsubsidized electricity and fuel oil prices in effect at the time of the audit, the total predicted energy costs are \$13,055 per year. This includes \$6,809 for electricity and \$6,246 for #1 fuel oil.

Table 1 lists the predicted annual energy usage before and after the proposed retrofits for the Tyonek Tribal Center.

Table 1: Predicted Annual Energy Use for the Tyonek Tribal Center

Predicted Annual Fuel Use				
Fuel Use	Existing Building	With Proposed Retrofits	Total Energy Savings	Total Cost Savings
Electricity	46,872 kWh	32,996 kWh	13,876 kWh	\$2,220
#1 Oil	1,315 gallons	1,041 gallons	274 gallons	\$1,302

PROPOSED ENERGY EFFICIENCY MEASURES (EEM)

Table 2 below summarizes the energy efficiency measures analyzed for the Tyonek Tribal Center. Listed are the estimates of the annual savings, installed costs, and two different financial measures of investment return. All costs assume that local labor will be used with no additional cost associated for travel or administrative tasks.

Table 2: Priority List - Energy Efficiency Measures

			Annual	locate Head	Savings to	Simple	60
			Energy	Installed	Investment	Payback	CO ₂
Priority	Feature	Improvement Description	Savings	Cost	Ratio, SIR ¹	(Years) ²	Savings
High	Setback	Install new programmable	\$2,029	\$1,000	26.26	0.5	11,369.3
	Thermostat: Tribal	thermostats for the forced					
	Center	air heating system and					
		program an unoccupied					
		temperature setback of					
		55 deg. F.					
High	Other Electrical:	Unplug coffee maker at	\$12	\$20	4.52	1.7	184.7
	Coffee Maker	the end of the day when					
		not in use.					

			Annual Energy	Installed	Savings to Investment	Simple Payback	CO ₂
Priority	Feature	Improvement Description	Savings	Cost	Ratio, SIR ¹	(Years) ²	Savings
Medium	Lighting: Offices	Replace with new, direct- wire LED equivalent lamps.	\$32	\$300	1.26	9.3	251.1
Medium	Lighting: Office Lights - Recently Converted	Replace with new, direct- wire LED equivalent lamps.	\$39	\$360	1.26	9.3	301.3
Medium	Lighting: Common Room Outer Ring	Replace with new, direct- wire LED equivalent lamps.	\$139	\$1,440	1.13	10.4	1,084.8
Medium	Above-Grade Wall: Walls	Add spray foam insulation to the rim joist of the walls and in between the logs within the structure. The effects of this retrofit are represented in both the wall insulation and air tightening categories.	\$382	\$7,983	1.06	20.9	2,139.0
Medium	Air Tightening	Add spray foam insulation to the rim joist of the walls and in between the logs within the structure. The effects of this retrofit are represented in both the wall insulation and air tightening categories.	\$346	\$3,000	1.04	8.7	1,938.5
Low	Lighting: Hallway, Office Lights	Replace with new, direct- wire LED equivalent lamps.	\$76	\$1,080	0.82	14.2	591.8
Low	Lighting: Office Lights	Replace with new, direct- wire LED equivalent lamps.	\$41	\$720	0.66	17.8	316.3
Low	Heating and Ventilation Systems	Clean air furnace and tune burners and fuel injection for optimal operation.	\$157	\$2,000	0.47	12.8	2,832.2
Low	Lighting: Restroom Fluorescents	Replace with new, direct- wire LED equivalent lamps.	\$2	\$120	0.22	53.6	17.5
Low	Lighting: Storage Room Incandescents	Replace with new, direct- wire LED equivalent lamps.	\$1	\$80	0.19	63.5	9.8
Low	Lighting: Basement CFL 22W	Replace with new, direct- wire LED equivalent lamps.	\$0	\$20	0.18	64.4	2.4
Low	Lighting: Basement Incandescent 75W	Replace with new, direct- wire LED equivalent lamps.	\$2	\$40	0.18	26.1	12.0
		TOTAL	\$3,257	\$18,163	2.35	5.6	21,050.7

FACILITY DESCRIPTION

Building Occupancy Schedules

The building is occupied from 9:00AM to 5:00PM five days per week as standard operating hours for the offices. The building is also used on weekends and during some evenings for community gatherings.

Building Shell

The building is a log structure with a crawl space beneath the flooring. There is a central large circular room with three wings of the building branching out from the center. The center room is used as the common area of the center. Two of the three wings hold office space and meeting rooms while the third wing holds a kitchen, restrooms, and storage. The wings all have attic spaces while the center room has a high ceiling.

The building has 67 individual windows, each of which is double pane glass with wood framing. There is approximately 1,053 square feet of window space in the building.

There are two entrances to the building. The center entrance is a set of wood double-doors with half-lite windows. The side entrance is a single wood door at the end of one of the building wings.

Heating Systems

The heating systems used in the building are:

Lennox Forced Air Heater

Fuel Type: #1 Oil

Input Rating: 142,000 BTU/hr Steady State Efficiency: 80 %

Idle Loss: 0.5 %

Heat Distribution Type: Air

Electric Hot Water Heater

Fuel Type: Electricity
Input Rating: 0 BTU/hr

Steady State Efficiency: 95 %

Idle Loss: 0 %

Heat Distribution Type: Water

Boiler Operation: All Year

Electric Heaters (5 total)

Fuel Type: Electricity Input Rating: 0 BTU/hr

Steady State Efficiency: 95 %

Idle Loss: 0 %

Heat Distribution Type: Air

Domestic Hot Water System

There is a 50-gallon hot water storage tank with the electric hot water heater. The heater is manufactured by the American Water Heater Company and is rated for 4500 Watts.

Lighting

Table 3: Lighting Information in the Tyonek Tribal Center

Room	Bulb Type	Fixtures	Bulbs per Fixture	Annual Usage (kWh)
Common Room – Outer Ring	Fluorescent T12 8ft. 96 W	12	2	2,371
Common Room – Main Lights	LED 8 Watt Screw-in Lamps	11	1	174
Hallway, Office Lights	Fluorescent T12 4ft. 40 W	9	4	1,577
Office Lights – T12	Fluorescent T12 4ft. 40 W	5	2	523
Office Lights – T8	Fluorescent T8 4ft. 32 W	6	4	980
Office Lights – Recently Converted	Fluorescent T12 4ft. 40 W	6	2	628
Basement CFL 22W	Fluorescent CFL Spiral 23 W	1	1	4
Basement Incandescent	Incandescent A Lamp 75 W	1	1	14
Restrooms	Fluorescent T12 4ft. 40 W	1	4	26
Storage Room	Incandescent A Lamp 40 W	2	1	15

The Native Village of Tyonek has been in the process of adding energy efficiency upgrades to this facility. There are office lights that have been recently converted to LED lamps. These have been modeled as the original fluorescent lamps in order to accurately portray the building during the time period that the electric usage data covers.

Electrical Equipment

Table 4: Major Electrical Equipment in the Tyonek Tribal Center

Equipment	Rating (Watts)	Annual Usage (kWh)
Refrigerator – Common Room	~ 225	2,000
Refrigerators (2) - Kitchen	~ 225 each	4,000
Chest Freezer	460	4,032
Microwave	1,800	329
Coffee Maker	1,575	1,530
Bass Guitar Speaker	400	84
Karaoke Machine	10	2
Large Office Printers (2)	1,470 each	269
Office Computers (5)	~ 250	2,374
Small Office Printer	27	3
Electric Range	~ 3,000	1,534

PROJECT FINANCING

The total estimated cost of the recommended EEM's \$18,163. The payback for the implemented EEM's is approximately 5.6 years. ANTHC is willing to assist the community with acquiring funds to complete the scope of work recommended in this energy audit.

There are several options for financing energy efficiency projects within the State of Alaska. These include the use of grants, loans, and other funding opportunities. Below is some information on potential funding opportunities.

Energy Efficiency Revolving Loan Program – This is a loan administered by the Alaska Housing Finance Corporation (AHFC) for use by any applicant who is also the owner of the building where the work will take place. It provides a loan for permanent energy-efficiency projects with a completion window of one year.

Sustainable Energy Transmission and Supply Program – This is a loan administered by the Alaska Energy Authority (AEA) for a government, business, or other organized body of people. It provides a loan for energy-efficiency or power transmission or distribution projects.

USDA-RD Communities Facilities Direct Loan & Grant Program - This is a loan or grant provided by the US Department of Agriculture – Rural Development (USDA-RD) for any essential community facility in a rural area. It provides a loan or grant to develop essential community facilities with upgrades or equipment for improvement.

MEASUREMENT AND VERIFICATION

The results of these recommended measures can be measured through the collection of energy use data through the monthly bills provided by the local electric utility and the local fuel oil supplier. Collecting data and performing a historical comparison is the simplest method of validating the energy and cost savings seen by the measures. Additionally, active remote monitoring systems are available that can collect and store data regarding energy and fuel usage. These systems allow the user to track the usage in real time and can be shared more easily with partners across the state.

APPENDICES

Appendix A - Energy Billing Data

The table below shows the fuel and electricity data used during the energy modeling process to confirm the accuracy of the energy distribution. Electricity data was obtained from Chugach Electric. Fuel data was obtained from the Native Village of Tyonek and the distribution was approximated for the energy audit.

Month	Fuel Oil Use (gallons)	Electricity Use (kWh)
January	238	7,520
February	190	5,840
March	155	6,600
April	69	4,520
May	35	1,640
June	5	880
July	5	880
August	5	1,400
September	25	1,760
October	145	2,080
November	200	4,080
December	235	7,560

Appendix B - Energy Audit Report - Project Summary

ENERGY AUDIT REPORT – PROJECT SUMMARY				
General Project Information				
PROJECT INFORMATION	AUDITOR INFORMATION			
Building: Tyonek Tribal Center	Auditor Company: ANTHC-DEHE			
Address: P.O. Box 82009	Auditor Name: Kevin Ulrich and Kelli Whelan			
City: Tyonek	Auditor Address: 4500 Diplomacy Drive			
Client Name: Arthur Standifer	Anchorage, AK 99508			
Client Address: P.O. Box 82009	Auditor Phone: (907) 729-3237			
	Auditor FAX:			
Tyonek, AK 99682				
Client Phone: (907) 583-2111	Auditor Comment:			
Client FAX:				
Design Data				
Building Area: 4,905 square feet	Design Space Heating Load: Design Loss at Space:			
	85,113 Btu/hour			
	with Distribution Losses: 85,113 Btu/hour			
	Plant Input Rating assuming 82.0% Plant Efficiency and			
	25% Safety Margin: 129,746 Btu/hour			
	Note: Additional Capacity should be added for DHW			
	and other plant loads, if served.			
Typical Occupancy: 0 people	Design Indoor Temperature: 65 deg F (building			
	average)			
Actual City: Tyonek	Design Outdoor Temperature: -1.2 deg F			
Weather/Fuel City: Tyonek	Heating Degree Days: 9,722 deg F-days			
Utility Information				
Electric Utility: Chugach Electric	Average Annual Cost/kWh: \$0.145/kWh			

Annual Energy Cost Estimate							
Description Space Heating Water Heating Lighting Refrigeration Other Electrical Total Cost							
Existing Building	\$9,407	\$277	\$889	\$845	\$1,431	\$13,055	
With Proposed Retrofits	\$6,536	\$277	\$558	\$845	\$1,378	\$9,798	
Savings	\$2,872	\$0	\$331	\$0	\$54	\$3,257	


Building Benchmarks					
Description EUI EUI/HDD ECI					
Existing Building	(kBtu/Sq.Ft.) 68.0	(Btu/Sq.Ft./HDD) 6.99	(\$/Sq.Ft.) \$2.66		
With Proposed Retrofits	51.0	5.24	\$2.00		

EUI: Energy Use Intensity - The annual site energy consumption divided by the structure's conditioned area. EUI/HDD: Energy Use Intensity per Heating Degree Day.

ECI: Energy Cost Index - The total annual cost of energy divided by the square footage of the conditioned space in the building.

Appendix C - Actual Fuel Use versus Modeled Fuel Use

The graphs below show the modeled energy usage results of the energy audit process compared to the actual energy usage report data. The model was completed using AkWarm modeling software. The orange bars show actual fuel use, and the blue bars are AkWarm's prediction of fuel use.

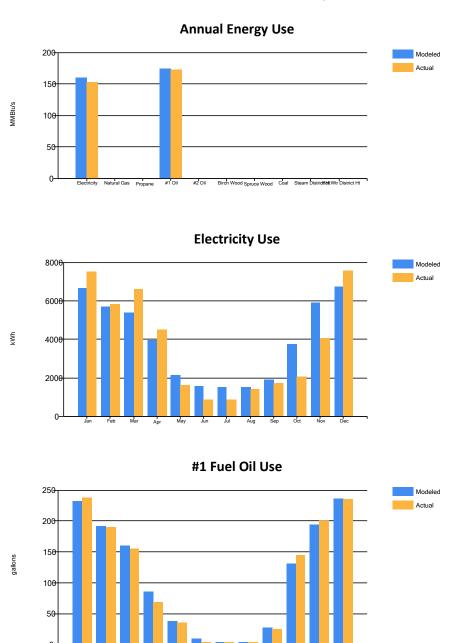

Appendix D - EUI Calculation Details

Electricity for the residential, commercial, and public facilities is provided by the Chugach Electric Association.

The average cost for each type of fuel used in this building is shown below in Table 5. This figure includes all surcharges, subsidies, and utility customer charges:

Table 5: Energy Cost Rates for each Fuel Type.

Average Energy Cost				
Description	Average Energy Cost			
Electricity	\$ 0.16/kWh			
#1 Oil	\$ 4.75/gallons			

Table 6 shows the calculated results for the building Energy Use Index (EUI), which determines the total energy usage for a type of building for comparison with other buildings of the same type. This allows the user to determine the relative energy use of a building in relation to others of the same type or use.

Table 6: EUI Building Calculations for the Tyonek Tribal Center

		Site Energy Use	Source/Site	Source Energy Use		
Energy Type	Building Fuel Use per Year	per Year, kBTU	Ratio	per Year, kBTU		
Electricity	46,872 kWh	159,974	3.340	534,312		
#1 Oil	1,315 gallons	173,569	1.010	175,305		
Total		333,542		709,616		
BUILDING AREA		4,905	Square Feet			
BUILDING SITE EUI		68	kBTU/Ft²/Yr			
BUILDING SOURCE EU	II	145	kBTU/Ft ² /Yr			
* Site - Source Ratio data is provided by the Energy Star Performance Rating Methodology for Incorporating						
Source Energy Use document issued March 2011.						

Table 7 shows information on common energy use benchmarks used to characterize the efficiency of a building.

Table 7: Building Benchmarks for the Tyonek Tribal Center

Building Benchmarks			
Description	EUI (kBtu/Sq.Ft.)	EUI/HDD (Btu/Sq.Ft./HDD)	ECI (\$/Sq.Ft.)
Existing Building	68.0	6.99	\$2.66
With Proposed Retrofits	51.0	5.24	\$2.00

EUI: Energy Use Intensity - The annual site energy consumption divided by the structure's conditioned area. EUI/HDD: Energy Use Intensity per Heating Degree Day.

ECI: Energy Cost Index - The total annual cost of energy divided by the square footage of the conditioned space in the building.

Appendix E - Materials List and Labor Estimation


Table 8 & 9: Materials List and Cost Estimation for Tyonek Tribal Center EEM's

Energy Retrofit	Required Materials	Quantity	Cost per Item	Total Materials Cost
Lighting – T8 4ft. Replacements	T8 4ft. LED equivalent lamps	82	\$15	\$1,230
Lighting – Screw-in Bulb Replacements	LED 10W Screw-in Bulbs	4	\$25	100
Lighting – T8 8ft. Replacements	T8 8ft. LED equivalent lamps	24	\$30	\$720
Air Tightening	Weather Stripping, Spray Foam, Window Film	1	\$2000	\$2000
Air Furnace Tuning and Controls	Burner, Controls	1	\$500	\$500
Setback Thermostats	Thermostats	1	\$200	\$200

Category	Cost (\$)
Labor	8,322
Travel	3,050
Materials	4,750
Freight	713
Indirect	1,683
Total	18,517

Appendix F - Materials Specifications

Robertshaw.

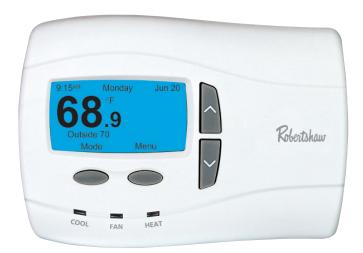

Programming Made Even Easier

Do you want to spend less time installing and setting up thermostats?

The new 9701i2 makes installation even easier with our new Setup Wizard. The Setup Wizard allows you to spend 50% less time setting up the thermostat over competitive models. Plus everything is in plain language so there are no complicated codes or button combinations to memorize.

We've also made programming even easier for your customers. Menus are easier to navigate. We've even added additional convenience features such as Automated Time adjustment for Daylight Saving Time, along with new indoor air quality reminders.

The new 9701i2 is so user friendly, it sets a higher standard in efficiency and simplicity for programmable thermostats. It is truly programming made even easier.

Robertshaw - Simply the Right Choice™

9701ⁱ2

DELUXE PROGRAMMABLE THERMOSTAT









GAS

ELECTRIC

OIL

HEAT PUMP

Menu Driven Display 1 Heat / 1 Cool

Features and Benefits



Set-up Wizard

Helps speed through the installation process with step-by-step setup and programming instructions.




Trilingual Display Option

Set to your customers' language of choice – English, Spanish or French



Convenient Displays

View a full day of programming at once for quick review or easy adjustment.



Contractor ID Feature

Set it yourself or custom order with your information pre loaded. Your name and phone number remind your customers when service is needed.

Daylight Saving Time Adjustment

Automatically adjusts to correct time regardless of seasonal changes.

Adjustable Backlighting

Choose to have backlighting on at all times or only when programming. You can also adjust the brightness and contrast for improved readability.

Time of Day Zoning

When coupled with a remote sensor (part #9020i), you can control the temperature in remote locations given different scheduled events.

Three Levels of Security

Secure protection against unwanted changes to the programming menus, temperature or set-up functions with your own 4-digit PIN.

Auto Changeover

Automatically adjusts between heating and cooling cycles to maintain optimal comfort.

Worry-Free Memory Storage

Even during power outages, the thermostat maintains set point and programmed parameters.

Adjustable Temperature Offset

Change the displayed temperature from the actual sensed temperature.

Adjustable Temperature Differential

Maintains optimal customer comfort.

Intermittent Fan

Maintains optimal air filtration and circulation with minimal energy

An ISO 9001 – 2008 Certified Company California Title 24 Compliant










970112 DELUXE PROGRAMMABLE THERMOSTAT

Terminal Designations

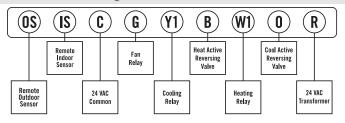

Technical Specifications

Electrical Rating	24 Volt AC (18-30 VAC) 1 amp maximum load per terminal (relay outputs) 3 amp total maximum load (all terminals combined)
Temperature Control Range	45°- 90°F (7°- 32°C)
Accuracy	+/-1.0°F (+/-0.5°C)
Power Source	24 VAC
Auto Changeover Deadband	Selectable 2° to 8°F
Temporary Temperature Override	3 hour maximum or next setpoint
Remote Sensor Capable	1 indoor and 1 outdoor sensor
System Configurations	Single-stage gas, oil or electric heating/cooling systems and single stage heat pump
Terminations	R, W1, Y1, B, O, G, C, IS, OS

Shipping Specifications

Indiv. Ctn. Dim.: 6.625" x 4.25" x 1.625" Master Ctn. Qtv.: 6

Master Ctn. Dim.: 9.25" x 5.625 x 7.5"

Master Ctn. Cu. Ft.: .23 Master Ctn. Wt.: 3.5 lbs. Max. Pallet Qty.: 1260 Max. Pallet Wt.: 785 lbs. Item 9020i and 9025i Remote Sensors

Indiv. Ctn. Dim.: 2.625" x 1.5625" x 4.4375"

Master Ctn. Qty.: 6

Master Ctn. Dim.: 5.625" x 5.125" x 5.125"

Master Ctn. Cu. Ft.: .09 Master Ctn. Wt.: .78 lbs.

Replacement Chart

	9701i2					
Braeburn®	5000					
Honeywell	TH8110U1003					
White-Rodgers	1F95-1271, 1F90-51, 1F90-71, 1F90-371, 1F97-51, 1F97-71, 1F97-371					
Carrier	TC-PAC, TC-PHP, P274-1100, P374-1100, P474-1100					
Lux	PSPA711					

Verify specific application requirements before substitution.

Patent Information

This product is covered by one or more of the following U.S. patents. Foreign patent rights may be pending. 4967382, 5803357, 6502758, 7000849, D301207, D462940

in∨e.ns.as Controls

191 E. North Avenue
Carol Stream Illinois 60188 USA
Customer Service Telephone 1.800.304.6563
Customer Service Facsimile 1.800.426.0804
HVACCustomerService@InvensysControls.com

For Technical Service Telephone 1.800.445.8299 Facsimile 1.630.260.7294 TechnicalService@InvensysContrtols.com

Invensys[™], Robertshaw[®] and Simply the Right Choice[™] are trademarks of Invensys plc., its subsidiaries and/or affiliated companies. All other brands mentioned in this report may be the trademarks of their respective owners.



Feature Comparison

	Invensys i2-Series	Honeywell Vision Pro	Carrier Infinity	White-Rodgers 1F97-371
Menu Driven (Ease of Programming)	Х			
Installation Wizard	Х			
Displays Complete Program	Х			
Adjustable Backlighting	Х			
Cooling System Monitor	Χ			
Heating System Monitor	Х			
Multi-Language	Х			
1/2 Degree Resolution	Х			
Time of Day Zoning	Х			
5/2 Program	Х			Х
24 Hour Programming	Х			Х
7-Day Programming	Х	Х	Х	
Large Display	Х	Х	Х	
Adjustable Timed Override/Hold	X	Х		
Automatic Daylight Saving Time Adjustment	X	X		
Adjustable Temperature Limits	X	X		
High/Low Balance Points	X	X		
LED Status Indicators	X	X		
Adjustable Differential	X	X		
Adjustable Compressor Short Cycle				
Protection	Х	Х		
Adjustable Residual Cooling	Χ	Х		
Fossil Fuel Kit required on HP units	No	No	Yes	Yes
Battery Free Memory Retention	Χ		Χ	
Manual Override	Х	Х	Х	Х
Resume	Х	Х	Х	Х
Auto Changeover	Х	Х	Х	Х
Gas/Electric	Х	Х	Х	Х
Single Stage Heat Pump Compatible	Х	Х	Х	Х
Line Powered	Х	Х	Х	Х
Programmable Fan	Х	Х	Х	Х
Intermittent Fan	Х		Х	1
°F and °C	Х	Х	Х	Х
12 or 24 Hour	Х	Х		Х
Air Filter Monitor	Х	Х	Х	Х
Humidifier Pad Monitor	Х	Χ	Х	
UV Light Monitor	X	Х	X	
Vacation Setting	X	Х	X	Х
0 & B Terminals	X	X	Partial	X
Events per day	2, 4, 6	4	4	2, 4
Remote Outdoor Sensor	χ	Combo	X	χ
Remote Indoor Sensor	X	0000	X	X
Energy Efficient Recovery	X	Х	X	X
Pre-set Program	X	X	X	X
Hidden Service Level	X	X	X	^
Security Key Pad	X	^	^	Х
Temperature Recalibration	X	Х	Х	^
Customizable Contractor ID	X	^	^	Factory Only
OUSCOMIZABLE CONTRACTOR ID	^			ractory offly



User Guide

Programmable Thermostat

Temperature preset buttons Appears when the ₩ (setpoint is displayed Time and day Temperature Set the day 88;88 (Hour) Set the time Operating (Min) mode icons Program the Pgm schedule Temperature preset icons Skip a period Clear 11 12 KANGA Heating power (Mode) Select the indicator operating mode Periods Temperature adjustment

0

Description

This programmable thermostat can be used to control an electric heating system such as an electric baseboard heater, a radiant ceiling, a radiant floor, a convector, etc.

buttons

The thermostat cannot be used under the following conditions:

- The resistive load is greater than 16.7 A
- The resistive load is less than 2 A
- The system is driven by a contactor or relay (inductive load)
- The system is a central heating system

SUPPLIED PARTS:

- One (1) thermostat
- Two (2) 6-32 screws
- Two (2) solderless connectors



Installation


TURN OFF POWER TO THE HEATING SYSTEM AT THE MAIN POWER PANEL TO AVOID ELECTRICAL SHOCK.

THE INSTALLATION MUST BE PERFORMED BY AN ELECTRICIAN.


- All cables and connections must conform to the local electrical code
- Special CO/ALR solderless connectors must be used when connecting with aluminum conductors.
- Install the thermostat onto an electrical box.
- Install the thermostat about 5 feet high, on an inside wall facing the heater.
- Avoid locations where there are air drafts (such as the top of a staircase or an air outlet), dead air spots (such as behind a door), or direct sunlight.
- Do not install the thermostat on a wall that conceals chimney or stove pipes.
- The thermostat wires are not polarized; either wire can be connected to the load or to the power supply.

NOTE: Always keep the thermostat's vents clean and unobstructed.


0



Connect the thermostat wires to the line wires and to the load wires using solderless connectors for copper wires.

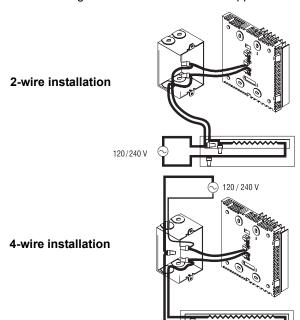

Oush any excess wire back into the electrical box.

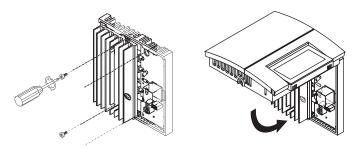

NOTE: If necessary, before re-installing the front component, configure the thermostat (see section 3).


• Return power to heating system.

TH106 400-106-001-D 12/8/05 1/3



Configuration

The configuration switches are on the back of the thermostat. The factory settings are indicated by the gray cells in the following table.



SW1	Early Start ^a	Off	On
SW2	Temperature / time format b	°C / 24-hour	°F / 12-hour
SW3	Cycle length ^c	15 seconds	15 minutes
SW4	Not used	-	-

- Early Start can be used in Automatic mode only. When this function is enabled, the thermostat calculates the optimal time to start heating in order to obtain the desired temperature by the set time. The thermostat re-assesses the start time daily based on the previous day's performance.
- b. If you change the temperature display format, the preset temperatures (*, (and i) will return to their default settings.
- c. 15-second cycles should be selected in most cases as it provides better temperature control. 15-minute cycles must be selected if you have a fan-equipped heater or if 15-second cycles causes light flickering (especially in rural regions).



Power-up

Upon power-up, the thermostat is in manual mode (%) and displays the actual (ambient) temperature.

- Press the **Hour** and **Min** buttons to set the thermostat's clock.
- 2 Press the Day button to set the day.



Temperature Setting

Setpoint

The thermostat normally displays the actual temperature. To view the setpoint, press the \blacktriangle or \blacktriangledown button briefly. The setpoint will appear for the next 5 seconds.

To change the setpoint, press the ▲ or ▼ button until the desired temperature is displayed. To scroll faster, hold the button.

Using a preset temperature

The thermostat has 3 preset temperatures:

- ▶ Comfort temperature ※
- ▶ Economy temperature 《
- Vacation temperature

Icon	Intended use	Factory setting
\ \\	Comfort (when at home)	21°C (70°F)
C	Economy (when asleep or away from home)	16.5°C (62°F)
	Vacation (during prolonged absence)	10°C (50°F)

- To use the Vacation temperature, press both ☆ and ℂ buttons simultaneously. The ஞ icon will be displayed.

Storing a preset temperature

To store the Comfort or Economy temperature:

Set the desired temperature using the $_{\blacktriangle}$ or $_{\blacktriangledown}$ button. Press and hold the appropriate button ($_{\diamondsuit}$ or $_{\circlearrowleft}$) for approximately 3 seconds until the corresponding icon is displayed. Press the **Mode** button.

To store the Vacation temperature:

Set the desired temperature using the ▲ or ▼ button. Press and hold both ☆ and ℂ buttons simultaneously for approximately 3 seconds until the ඪ icon is displayed. Press the **Mode** button.

6

Operating Modes

Automatic - The temperature is set according to the programmed schedule. To place the thermostat in this mode, press Mode until is displayed. The icons of the current period and preset temperature are also displayed.

Temporary Bypass: If you modify the setpoint (by pressing the \blacktriangle , \blacktriangledown , \Leftrightarrow or \lang button) when the thermostat is in automatic mode, the new setpoint will be used until the end of the current period. When the next period starts, the temperature set for that period becomes the new setpoint.

Manual - The programmed schedule is not used. The temperature must be set manually. To place the thermostat in this mode:

- Press Mode until //>
 // is displayed.
- Set the temperature using the ▲, ▼, ☆ or 《 button.



Schedule

The schedule consists of 4 periods per day which represents a typical weekday. You can program the thermostat to skip the periods that do not apply to your situation. For example, you can skip periods 2 and 3 for the weekend.

Period	Description	Associated temperature preset
邻	Wake	⊹
(2) **	Leave	(
(°) + ±	Return	*
125	Sleep	Q

The Comfort (*) temperature is used in periods 1 and 3 and the Economy (%) temperature is used in periods 2 and 4. For example, when the period changes from 1 to 2, the setpoint automatically changes from Comfort setting (%) to Economy setting (%).

You can have a different program for each day of the week; i.e., each period can start at different time for each day of the week. The thermostat has been programmed with the following schedule.

Period	Setting	МО	TU	WE	TH	FR	SA	SU
វាំ	-\ ' \-	6:00 AM						
12 A+	C	8:00 AM	8:00 AM	8:00 AM	8:00 AM	8:00 AM	:	:
7 €1	-\ ' \-	6:00 PM	6:00 PM	6:00 PM	6:00 PM	6:00 PM	:	:
ি	C	10:00 PM						

To modify the schedule:

- Press Pgm to access the programming mode. Period 1 is selected.
- Press Day to select the day to program (hold for 3 seconds to select the entire week).
- Press Hour and Min to set the start time of the selected period, or press Clear if you want to skip the period (--:-- is displayed).
- Press Pgm to select another period, or press Day to select another day. Then repeat step 3.

TH106 400-106-001-D 12/8/05 2/3

Press Mode to exit the programming mode.

NOTE: If no button is pressed for 60 seconds, the thermostat will automatically exit the programming mode.



Power Outage

During a power outage, the settings are stored in memory. However, only the thermostat's clock must be re-adjusted if the power failure lasts more than 2 hours. When power comes back, the thermostat will return to the operating mode that was active prior to the power failure.



Troubleshooting

PROBLEM	SOLUTIONS
Thermostat is hot.	This condition is normal. Under normal operation, the thermostat housing can reach a temperature between 35°C (95°F) and 40°C (104°F).
Heater is always On.	The thermostat has not been correctly wired.
Thermostat indicates that heating is On, but the heater is not On.	The thermostat has not been correctly wired.
Wrong temperature is displayed.	The thermostat is exposed to air draft. Eliminate the draft. The sticker on the thermostat's screen has not been removed.
Wrong time is displayed.	The thermostat was without power for more than 2 hours.
Temperature does not change according to the programmed schedule.	Check that the thermostat is in Automatic mode. Check the schedule and clock settings.
Display disappears and reappears after a few minutes.	The thermal protection device on the heater is open. This can happen after a power failure or if the heater is obstructed by furniture or curtains.
Display looks faded when heating is activated	The heating system is less than the required minimum load. This thermostat cannot be used below that rating.



Technical Specifications

Power: 120/240 VAC, 50/60 Hz

Minimum load: 2 A (resistive only)

500 W @ 240 VAC 250 W @ 120 VAC

Maximum load: 16.7 A (resistive only)

2000 W @ 120 VAC 4000 W @ 240 VAC

Display range: 0°C to 60°C (32°F to 140°F)

Display resolution: 0.5°C (1°F)

Setpoint range: 5°C to 30°C (40°F to 86°F)

Setpoint interval: 0.5°C (1°F)

Storage: -20°C to 50°C (-4°F to 120°F)

Approval: c UL us



Warranty

Aube warrants this product, excluding battery, to be free from defects in the workmanship or materials, under normal use and service, for a period of three (3) years from the date of purchase by the consumer. If at any time during the warranty period the product is determined to be defective or malfunctions, Aube shall repair or replace it (at Aube's option).

If the product is defective,

- (i) return it, with a bill of sale or other dated proof of purchase, to the place from which you purchased it, or
- (ii) contact Aube. Aube will make the determination whether the product should be returned, or whether a replacement product can be sent to you.

This warranty does not cover removal or reinstallation costs. This warranty shall not apply if it is shown by Aube that the defect or malfunction was caused by damage which occurred while the product was in the possession of a consumer.

Aube's sole responsibility shall be to repair or replace the product within the terms stated above. AUBE SHALL NOT BE LIABLE FOR ANY LOSS OR DAMAGE OF ANY KIND, INCLUDING ANY INCIDENTAL OR CONSEQUENTIAL DAMAGES RESULTING, DIRECTLY OR INDIRECTLY, FROM ANY BREACH OF ANY WARRANTY, EXPRESS OR IMPLIED, OR ANY OTHER FAILURE OF THIS PRODUCT. Some provinces and states do not allow the exclusion or limitation of incidental or consequential damages, so this limitation may not apply to you.

THIS WARRANTY IS THE ONLY EXPRESS WARRANTY AUBE MAKES ON THIS PRODUCT. THE DURATION OF ANY IMPLIED WARRANTIES, INCLUDING THE WARRANTIES OF MERCHANT-ABILITY AND FITNESS FOR A PARTICULAR PURPOSE, IS HEREBY LIMITED TO THE THREE-YEAR DURATION OF THIS WARRANTY. Some provinces and states do not allow limitations on how long an implied warranty lasts, so the above limitation may not apply to you.

This warranty gives you specific legal rights, and you may have other rights which vary from province or state to another.



Customer Assistance

If you have any questions about the product installation or operation, or concerning the warranty, contact us at:

705 Montrichard

Saint-Jean-sur-Richelieu, Quebec J2X 5K8

Canada

Tel.: (450) 358-4600 Toll-free: 1-800-831-AUBE Fax: (450) 358-4650

Email: aube.service@honeywell.com

For more information on our products, go to www.aubetech.com



As an Energy Star $^{(\!R\!)}$ partner, Aube Technologies has determined that this product meets the Energy Star guidelines for energy efficiency.

TH106 400-106-001-D 12/8/05 3/3





■ Notify Me when Available

Large Project? Click here to get a volume quote.











DESCRIPTION

SPECIFICATIONS

REVIEWS

EarthLED Total Product Insight

PERFORMANCE SPECIFICATIONS

REPLACEMENT FOR: T8 OR T12 4 FOOT FLUORESCENT TUBE

BRIGHTNESS (LUMENS): 2000

COLOR TEMPERATURE: 4000K | 5000K

COLOR ACCURACY (CRI): 80

DIMENSIONS 1.02" X 47.2"

POWER CONSUMPTION: 18 WATTS

VOLTAGE: 120-277 VOLTS

DIMMABLE: NO

DIMENSIONS / ADDITIONAL DATA

CERTIFICATIONS: UL, DESIGNLIGHTS (DLC)

PRODUCT/ORDER CODE: 4000K - 18WT8P-4F-40K-BYP 5000K - 18WT8P-4F-50K-BYP

LIFESPAN / COST TO RUN

PROJECTED LIFE:

@3 HRS/DAY 50,000 HRS

YEARLY ENERGY COST: \$2.17

3 HRS/DAY @ .11 KWH

WARRANTY 5 YEAR THINKLUX LIGHTING LIMITED WARRANTY

EARTHLED PRODUCT PROTECTION PLAN IS AVAILABLE

DirectLED - 8 Foot - LED Fluorescent Replacement Tube - Ballast Bypass - 36 Watt - 3900 Lumens - Frosted Lens

EarthLED Total Product Insight **Performance Specifications** REPLACEMENT FOR: F96 T8, T12 8 FOOT FLUORESCENT TUBE BRIGHTNESS (LUMENS): 3900 COLOR TEMPERATURE: 3000K | 4000K | 5000K | 6000K COLOR ACCURACY (CRI): 80 **DIMENSIONS** 1.02" X 96" (BI-PIN, SINGLE PIN) | 1.02" X 93.91" (R17D) POWER CONSUMPTION: 36 WATTS 100-277 VOLTS VOLTAGE: DIMMABLE: NO **Dimensions / Additional Data CERTIFICATIONS:** UL (G13 BI-PIN, R17D) PRODUCT/ORDER CODE: DL-FY-T8-2400NF-FROSTED Lifespan / Cost To Run PROJECTED LIFE: 50,000 HRS @3 HRS/DAY YEARLY ENERGY COST: \$4.34 3 HRS/DAY @ .11 KWH

WARRANTY


5 YEAR FY LIGHTING LIMITED WARRANTY

EARTHLED PRODUCT PROTECTION PLAN IS AVAILABLE

EarthLED Total Product Insight	
Performance Specifications	
REPLACEMENT FOR:	E12 CANDELABRA
BRIGHTNESS (LUMENS):	500
COLOR TEMPERATURE:	3000K 5000K
COLOR ACCURACY (CRI):	>80
TRADITIONAL WATTAGE EQUIVALENT:	60 WATTS
POWER CONSUMPTION:	7 WATTS
VOLTAGE:	120 VOLTS
DIMMABLE:	YES
MOISTURE RATING:	DAMP
FIXTURE RATING:	OPEN FIXTURES
BASE TYPE:	E12
ENERGYSTAR QUALIFIED:	YES (TKUCA38S01-7W-D-830-E12)
Dimensions / Additional Data	
BULB DIAMETER:	1.6 IN
MAXIMUM OVERALL LENGTH:	4.9 IN
PRODUCT WEIGHT:	6.7 OUNCES
CERTIFICATIONS:	UL
PRODUCT/ORDER CODE:	3000K - TKUCA38S01-7W-D-830-E12 5000K - TKUCA38S01-7W-D-850-E12
Lifespan / Cost To Run	
PROJECTED LIFE: @3 HRS/DAY	25,000 HRS
YEARLY ENERGY COST: 3 HRS/DAY @ .11 KWH	\$0.84
WARRANTY	3 YEAR THINKLUX LIMITED WARRANTY EARTHLED PRODUCT PROTECTION PLAN IS AVAILABLE



Window Jambs and Light-Duty Door Jambs

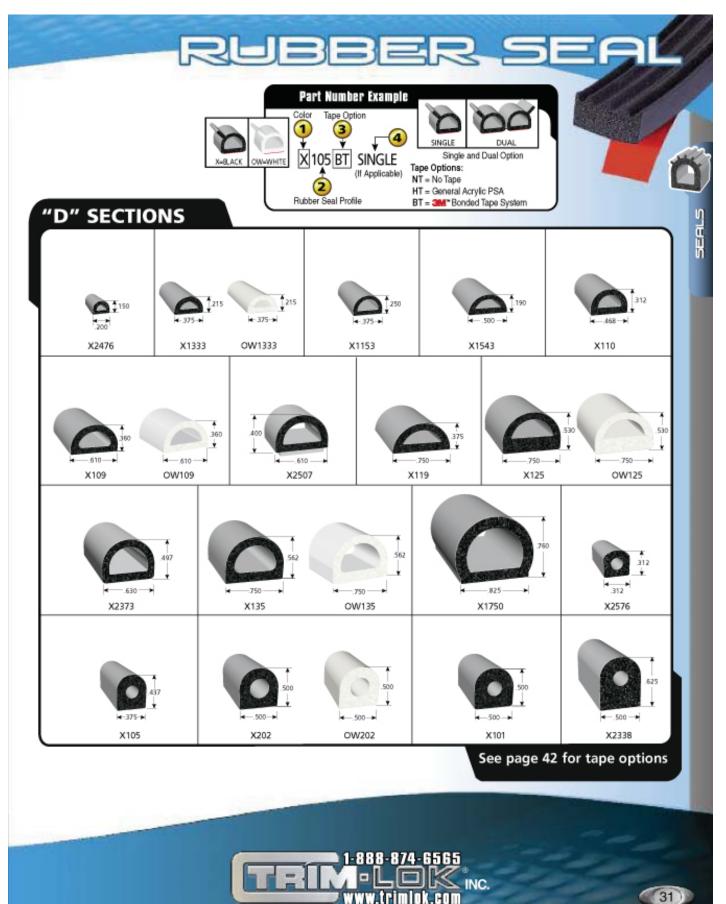


RUBBER SEAL






RUBBER SEAL



X1678









See page 42 for tape options

SECTIONS











Adhesive Options – Choose the tape that fits your needs

"HT" GENERAL PURPOSE PRESSURE SENSITIVE ADHESIVE

This acrylic based adhesive is best used to hold the rubber seal in place while installed in a static application or compressed between two stationary objects. May be used in some light duty dynamic applications against a variety of substrates. Good heat performance -20°F. to +158°F.

Please Note: During application ambient temperature must be above 60° F.

"BT" 3M" HIGH STRENGTH TAPE SYSTEM


The ultimate bond between the rubber and substrate. Creates a moisture barrier and air tight seal between rubber and substrate. Highest peel and shear resistance, can be used under high loads of stress and force. Has low initial tack for easy re-positioning during installation and requires 72 hours of cure time for full bond strength. Good heat performance -20°F. to +158°F.



See our How to Install video at: www.rubber-seal-install.info



PEDESTAL SEALS






SEALS

33


Door Bottom Sweep

(Replacement for Damaged Brush Sweep)

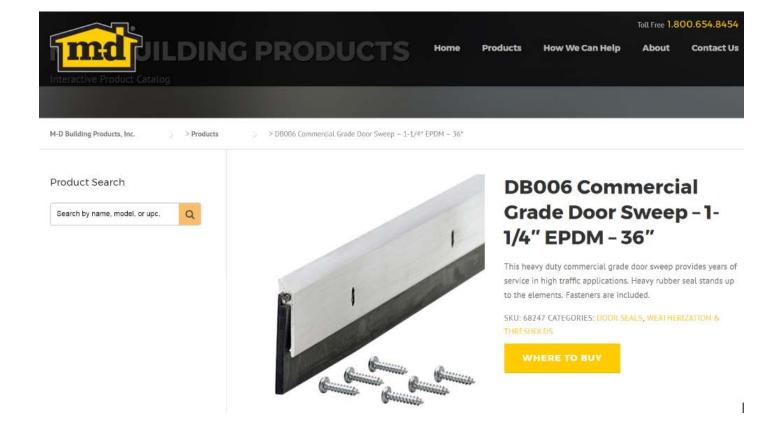


Door Bottom Sweep

(For Doors w/ Very Large Gaps and/or Damaged Bottom Edges)

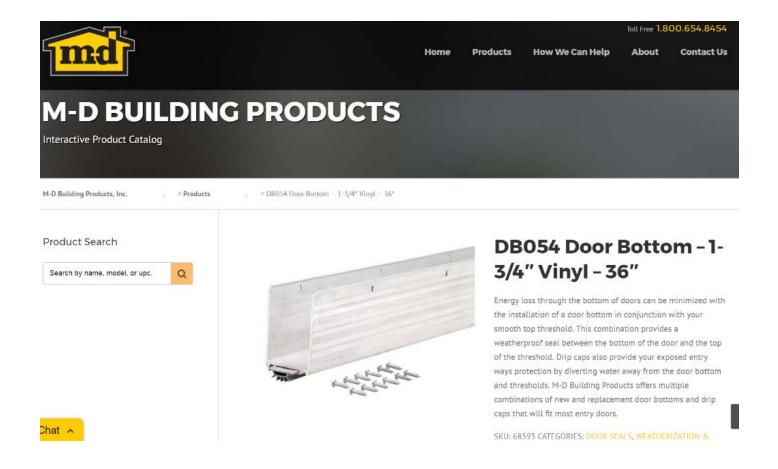


Door Bottom Sweep

(Lower Profile)

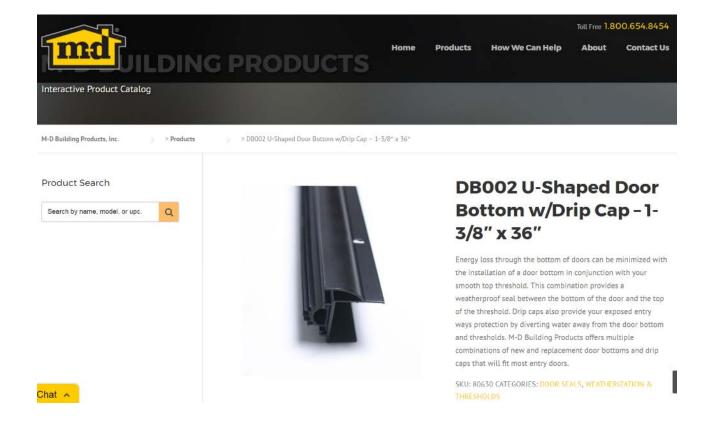

Door Top and Side Jambs

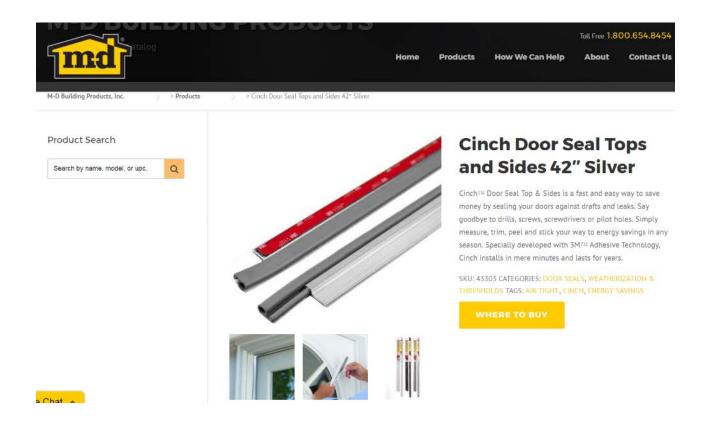





Bottom of Garage Doors



For Questions or Concerns, Please Call

(800) 992-2018


ProSeal™ U-shaped Garage Door Bottom Seal Installation Instructions

- Remove existing garage door bottom seal. Some garage door manufacturers will pinch the aluminum track to hold the bottom seal in place. To open a pinched track, insert a flathead screw driver, into the end of the track, and gently pry open the end, just enough to allow removal of the old door seal. Both ends of the track may need to be opened.
- Make sure any debris in the track has been removed and that it is clean and dry. Straighten out any cramps in the track.

Quick Tip: Mix a bucket of water with some liquid dish soap or liquid laundry detergent. Place the seal in the soapy water and pull it out as you install it into the track.

- 3. Starting at either end of the garage door, insert the ¼" T-ends, attached to the ProSeal™ Garage Door Bottom Seal, into the track. Next, slide the ProSeal™ into the track, until it reaches the opposite side. Continue to pull the seal until you have approximately 2" protruding beyond the end of the track.
- 4. Leave 2" protruding on both sides, then use scissors to trim off the excess ProSeal™. If your door seal track was pinched and you wish to pinch it back together, use pliers to gently pinch the track back into place. Now tuck the 2" of excess seal back into the U-shaped opening. This will lock the seal in place.





6345 Nancy Ridge Drive, San Diego, CA 92121 (858) 625-0005 • (800) 992-2018 • Fax (858) 625-0010 • Email: info@auto-care.com





Top and Sides of Garage Doors



Roll over image to zoom in

Pemko Brush Gasketing/Door Bottom, 45-degree, Clear Anodized Aluminum with 0.625" Gray Nylon Brush insert, 0.31" width, 0.25" Height, 72" Length

Be the first to review this item

Price: \$23.35 & FREE Shipping on orders over \$25—or get FREE Two-Day Shipping with prime

Usually ships within 1 to 2 months.

Ships from and sold by Amazon.com.

New (1) from \$23.35 & FREE shipping on orders over \$25.00. Details

Specifications for this item

Part Number Number of Items	45061CNB72	Height	0.25 inches
		Length	72 inches
		Material	Aluminum
UPC	086787113621	Model Number	45061CNB72
Brand Name	Pemko	Width	0.31 inches

Product features

- All brush seals greatly reduce the infiltration of light, air, wind, rain, and snow; prevent heat loss; control the penetration of smoke and fumes.
- The dense nylon filaments conform to the contours of every sealing surface, providing a superior seal with extremely low closing force.
- Brush remains flexible down to -40°F and has a melting point above 400°F.
- UV stabilized, dependable, long-lasting, cost-effective.
- All clear anodized brush products are supplied with gray brush

Product description

Brush Perimeter seals are designed to seal the gap between the door and the door jamb. They are surface mounted to the frame and are usually supplied with an angled flange provides the best contact between the brush and the surface of the door.

Product details

Shipping Weight: 9.6 ounces (View shipping rates and policies)

Domestic Shipping: Currently, item can be shipped only within the U.S. and to APO/FPO addresses. For APO/FPO shipments, please check with the manufacturer regarding warranty and support issues.

International Shipping: This item is not eligible for international shipping. Learn More

ASIN: BOOBUSTLNS

Item model number: 45061CNB72

Average Customer Review: Be the first to review this item

Amazon Best Sellers Rank: #754,396 in Industrial & Scientific (See Top 100 in Industrial & Scientific)

#144 in Industrial & Scientific > Commercial Door Products > Commercial Door Hardware > Trims, Seals & Gaskets

Manufacturer's warranty can be requested from customer service. Click here to make a request to customer service.